


# Security II Rackmount Quick Start Guide

This unit is shipped with the internal batteries disconnected.  
Before starting the UPM, please follow these battery connection instructions.



## 1. Remove UPM from the box



Some units may require 2 people to lift.

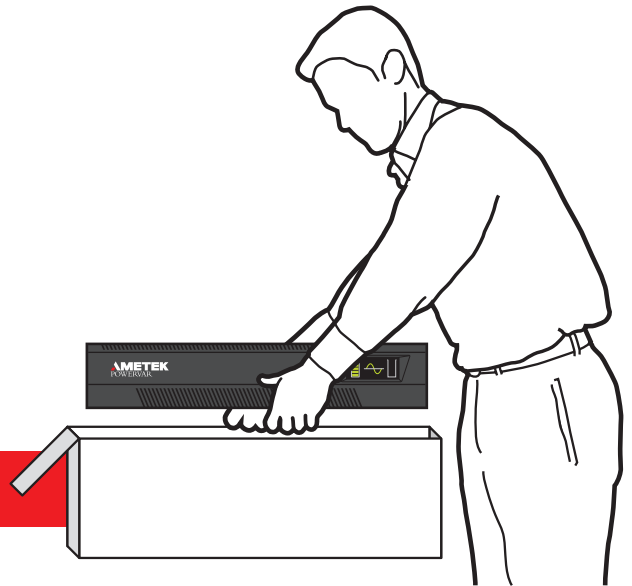

## 2. Attached included outlet cord and plug UPM into wall.

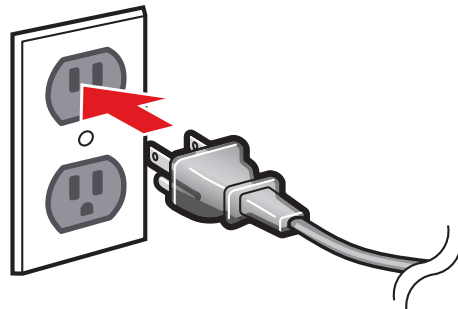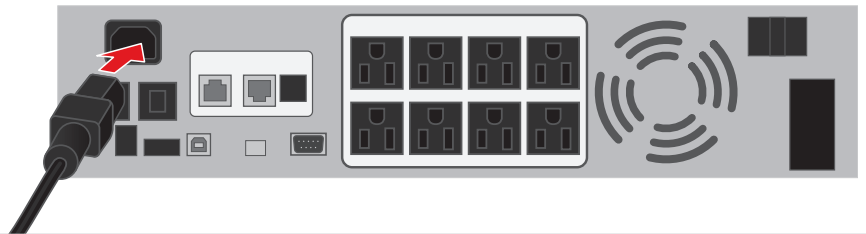


## 3. Remove the UPM front plastic cover and metal battery cover by removing the screws.



# Security II Rackmount Quick Start Guide


## 4. Connect battery connector.\*

Battery connectors may be partially hidden on the side of the battery.

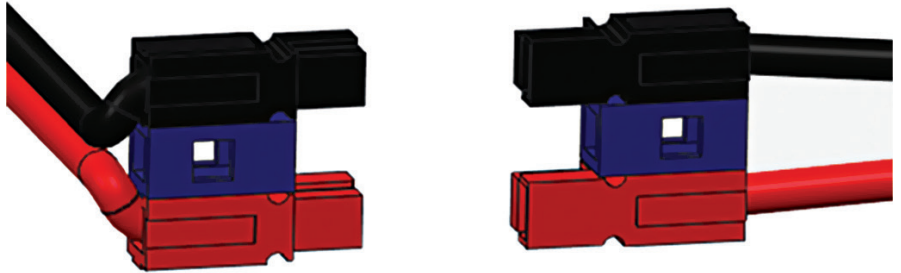

\*The 2.2 & 3KVA units connect 2 batteries

## 5. Put the metal battery cover and the front cover back on and remove the yellow warning label.

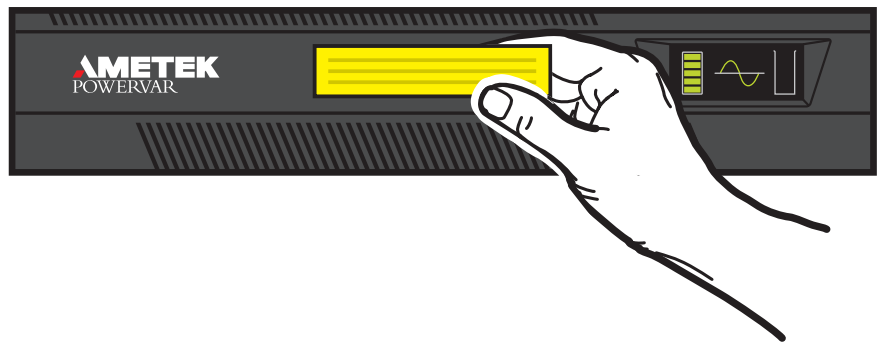

## IMPORTANT:

Wait 15 seconds after inserting the battery plug(s) before pressing the ON switch on the UPM front panel.

If you ship the UPM to another location at a later date, disconnect the battery plug(s) first to ensure that safety is maintained during shipment.

## 6. Turn UPM on by pressing ON button for 3 seconds

